


NO. 1 2010 EDITION
 MADE BY C. COLE
 DATE 03/10
 NO. 3 4
 DESCRIPTION OF REVISIONS

NOTES:

1. Electrical wires to flasher can be individual conductors or per a 7 conductor IMSA 19-1 Cable. The bond shall be a signal #8 AWG XHHW-2 insulated wire.
2. A minimum of two spare conductors shall be provided.

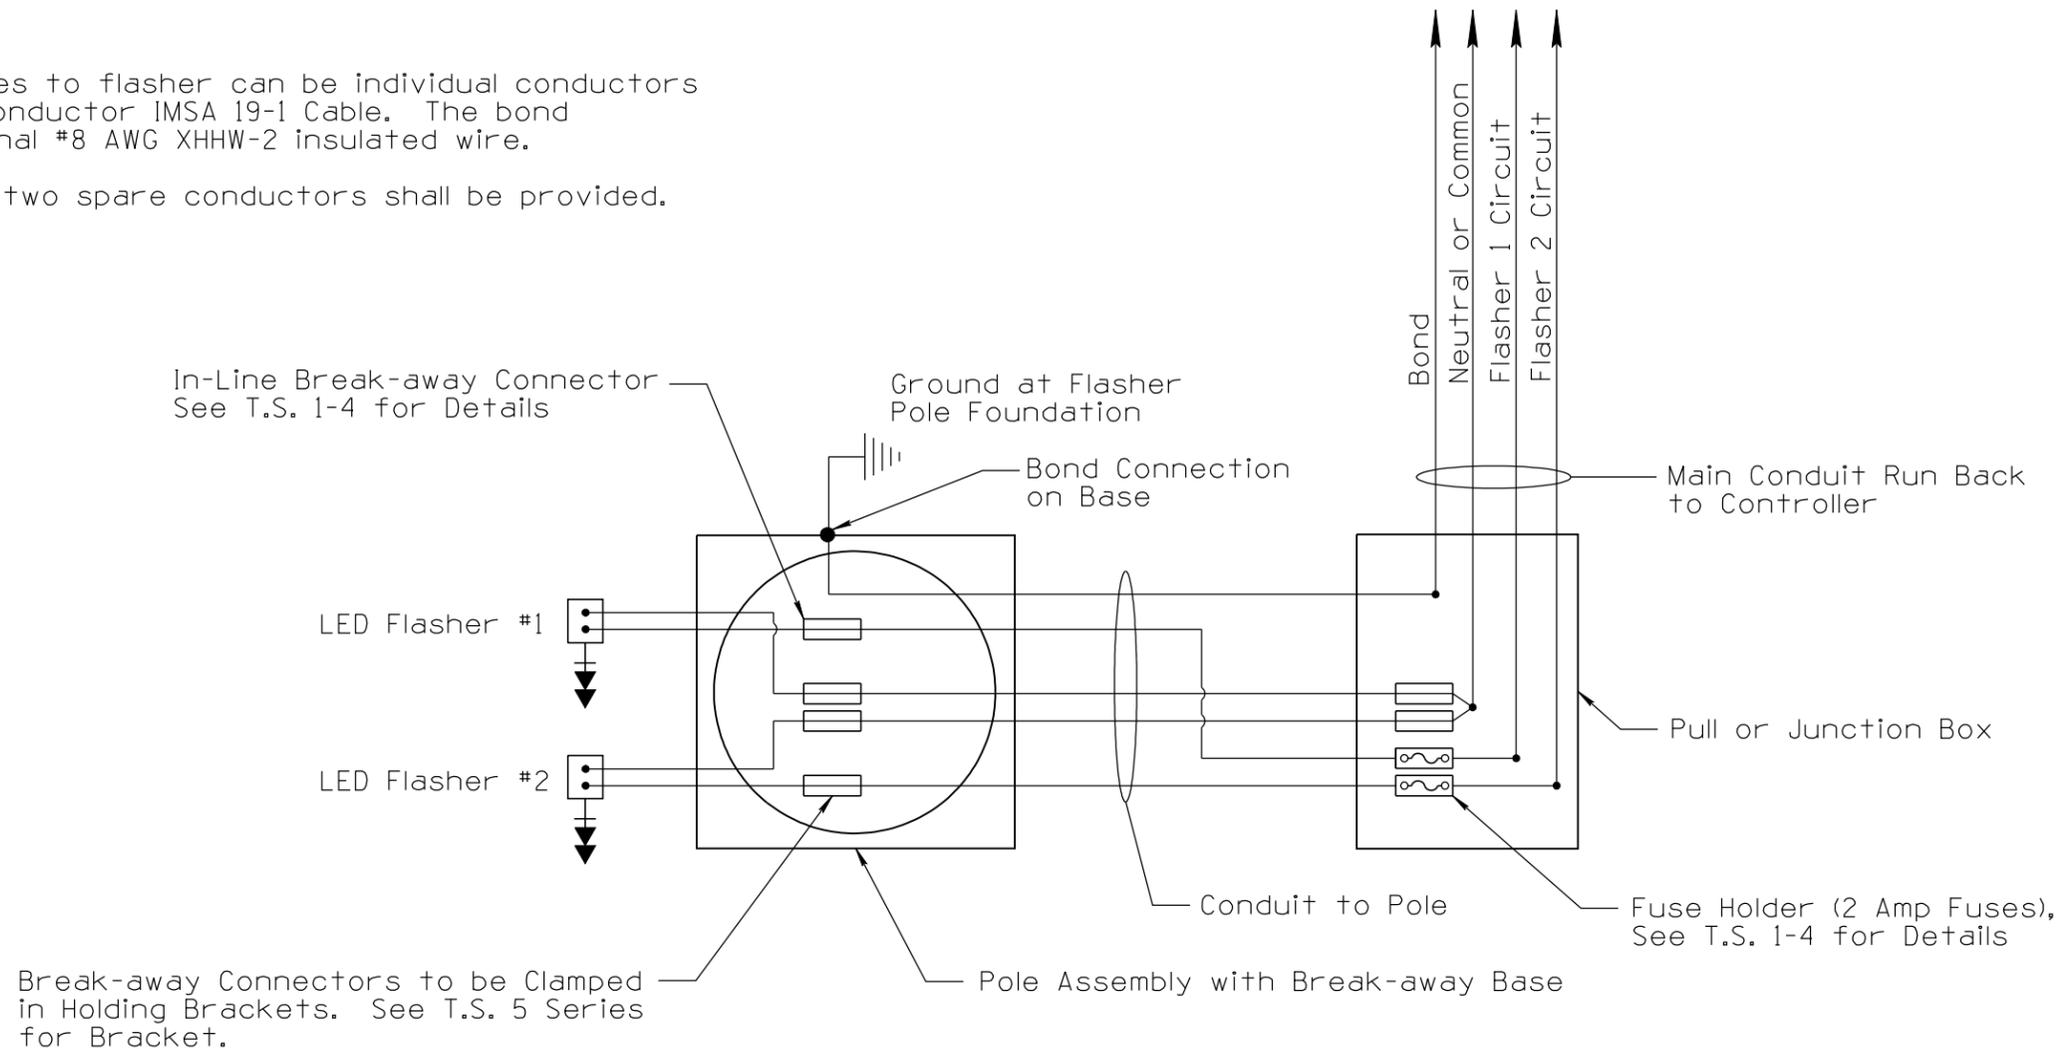

WIRING DIAGRAM FOR TYPICAL FLASHER POLE WITH BREAK-AWAY BASE FEATURE

Individual Conductors Color Code #14 AWG XHHW-2	
Black	Flasher #1
Red	Flasher #2
Yellow	Spare
Blue	Spare
White	Neutral or Common

5-7 Conductor Cable #14 G Color Code	
INSULATION COLOR	USE
Black	Flasher #1
Red	Flasher #2
All Other Colors	Spares
White	Neutral or Common

NOT TO SCALE

DESIGN APPROVED SIGNATURE	ARIZONA DEPARTMENT OF TRANSPORTATION INTERMODAL TRANSPORTATION DIVISION TRAFFIC SIGNALS AND LIGHTING STANDARD DRAWINGS	REVISION 03/10
APPROVED FOR DISTRIBUTION ON FILE	ADVANCE WARNING FLASHER POLE DETAILS	DRAWING NO. T.S. 12-1
		SHEET NO. 3 OF 3