



NO. 1 2010 EDITION
 MADE BY C. COLE
 DATE 03/10
 NO. 3 4
 DESCRIPTION OF REVISIONS
 MADE BY DATE
 DATE


Blank Cover if Service is Unmetered or Utility Approved 4-Jaw Meter Socket with Temporary Plastic Cover if Metered

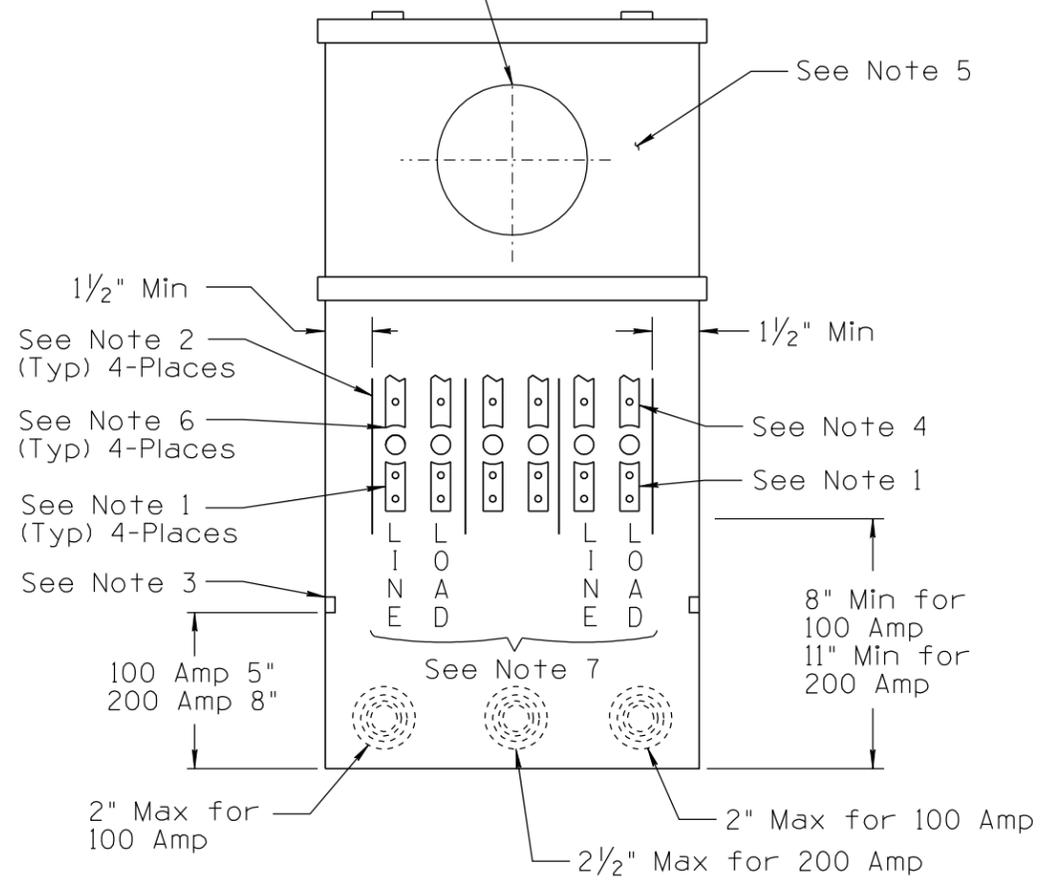

FRONT VIEW
(Lower Cover Removed)

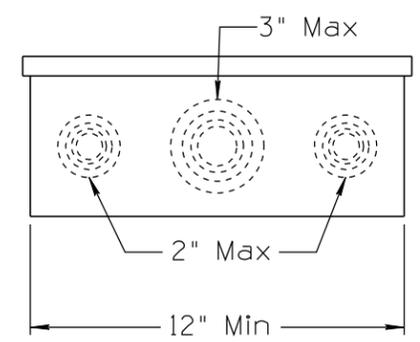


EUSERC UTILITY PULL SECTION DETAIL
(Bottom View)

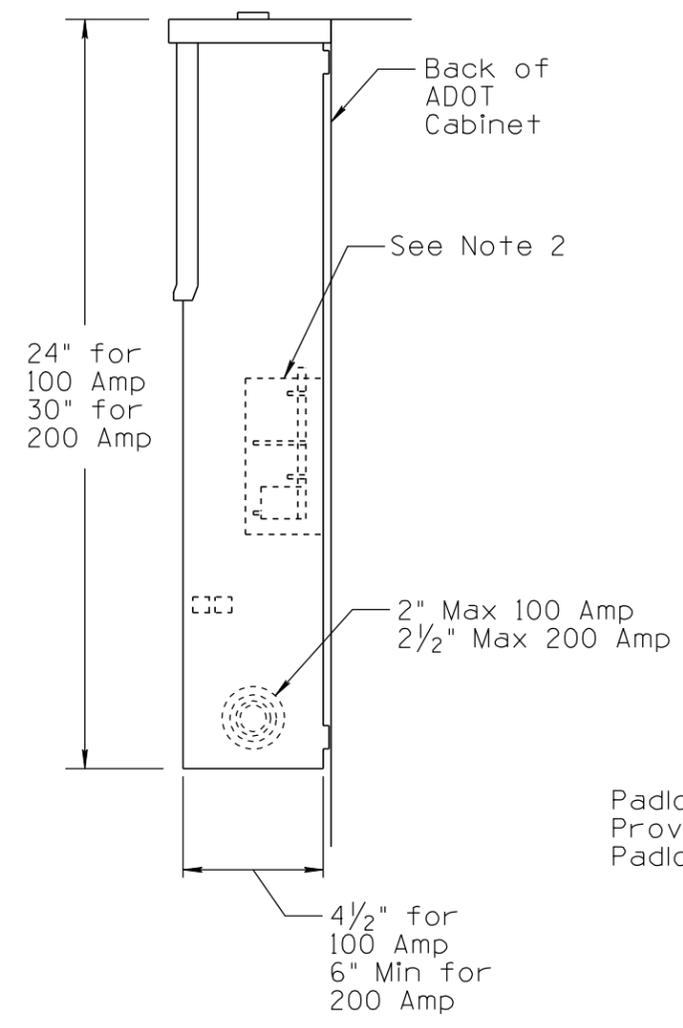


NOTES:

1. The 100 Amp service is to be used for traffic signal cabinet mounted services and Type II load centers.
2. The 200 Amp service is to be used with the Type IV load center.

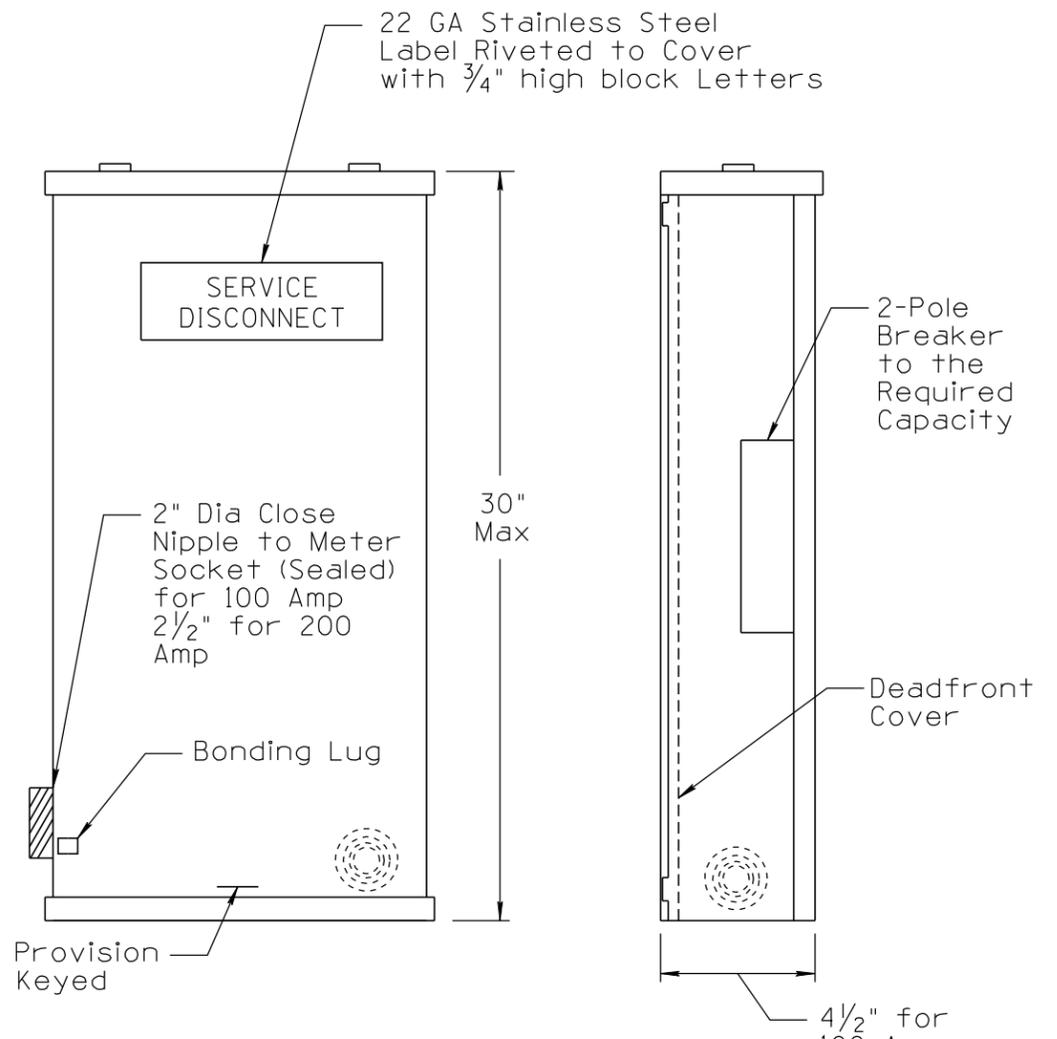

FRONT VIEW
(To Match Service Panel Rating)

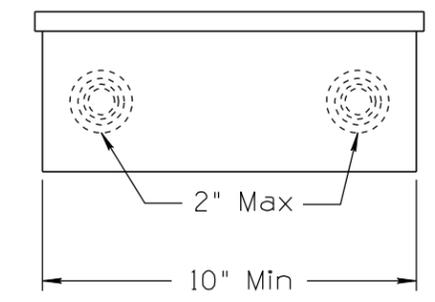

SERVICE DISCONNECT DETAIL
(Bottom View)

SEE NOTES ON SHEET 2 OF 2

DESIGN APPROVED SIGNATURE	ARIZONA DEPARTMENT OF TRANSPORTATION INTERMODAL TRANSPORTATION DIVISION TRAFFIC SIGNALS AND LIGHTING STANDARD DRAWINGS	REVISION 03/10
APPROVED FOR DISTRIBUTION ON FILE	120/240 OR 240/480 VOLT, SINGLE PHASE UTILITY PULL SECTION AND SERVICE DISCONNECT DETAILS	DRAWING NO. T.S. 3-12
		SHEET NO. 1 OF 2

NOT TO SCALE